



INSTRUCTION MANUAL



Please read before use!

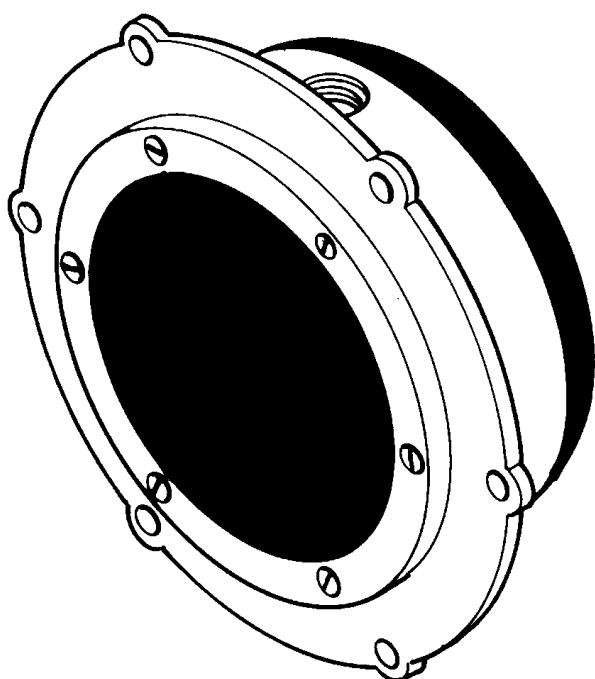


FMN 113

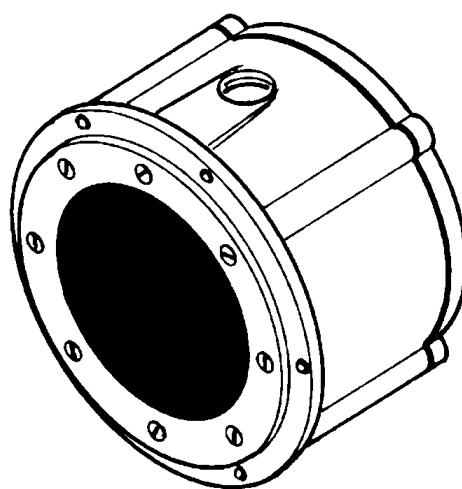

FMK 508

Level Indicator
Type **FMN** and **FMK**

Component Parts

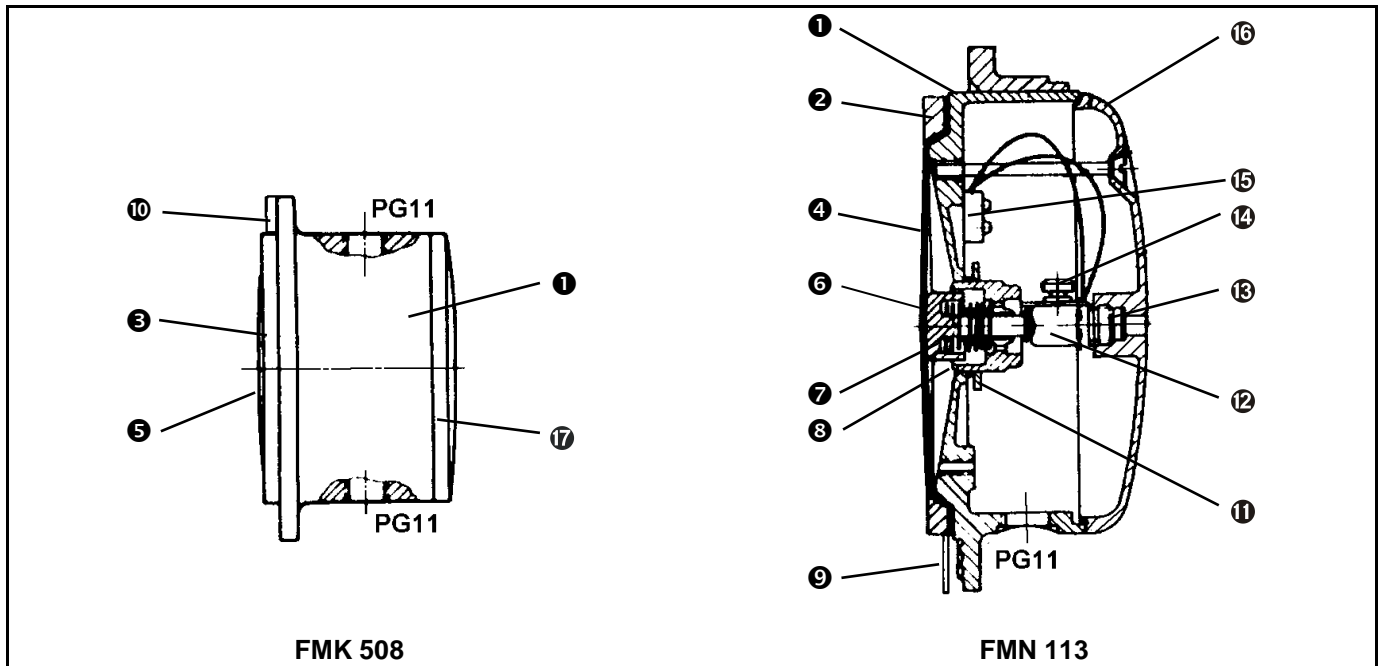

- | | |
|----------------------------|-----------------------|
| ① Body | ⑩ Gasket FMK |
| ② Diaphragm guard ring FMK | ⑪ Locking ring |
| ③ Diaphragm guard ring FMN | ⑫ Micro switch |
| ④ Flat diaphragm FMN | ⑬ Balancing filter |
| ⑤ Flat diaphragm FMK | ⑭ Knurled nut |
| ⑥ Tapped / Ram | ⑮ Connecting terminal |
| ⑦ Reset spring 20-60-250p | ⑯ Housing cover FMN |
| ⑧ Adjustable lining | ⑰ Housing cover FMK |
| ⑨ Gasket FMN | |

Packaging Content

Standard-contents

- 1 level indicator,
- 1 exchange spring.....60 p,
- 1 exchange spring....250 p,
- 1 instruction manual,
- 1 gasket.

Intended application and Security

- The level indicator is to be assembled following approved safety guidelines.
- The level indicator is intended exclusively for trained personnel. the indirect display of container / silo levels.
- Follow the instruction manual.
- Electrical installations may only be done by trained.
- Only work on the equipment if it is powered off.

Another use is not intended.

The manufacturer is not responsible for damage resulting from inappropriate use. That risk is carried by the user

Assembly

You can install this level indicator in any orientation provided it is adjusted appropriately (see chapter **adjustment**).


Installation in silo walls: FMN 113 ... to approx. 10 mm FMK

FMN 508 ... to approx. 6 mm FMK

Location: Fitted tightly to the inner wall

You will achieve this for thin-walled containers / silos by

- * Applying additional gaskets and / or
- * Adjusting the flange.



The fixing bolts must not project into the inside of the silo! This will avoid a possible accumulation of the filling material



The level indicator must not lie in the filling flow of the material! This prevents damage to the level indicator and especially to the diaphragm

The electrical conductions

- * To be installed on the outside wall of the silo,,
- * Insert into the housing of the level indicator by the tapped holes PG11.



Seal unnecessary tapped holes with plugs! This prevents the penetration of dust and humidity

Installation pattern		Explanation
Preferably granular, dusty filling material	Floury filling material	
<p>Anbau</p>	<p>Einbau</p>	<p>mit Filter</p>
<p> A = level indicator B = conduction if necessary* C = conduction if necessary* </p> <p>* (steel tube, if required)</p>		

Installation at higher temperatures

Allowed temperature	Materials in level indicator
max. 120°C	<u>Standard version</u> <ul style="list-style-type: none"> ➤ Plastic tappet ➤ BUNA-N diaphragms
max. 200°C	<u>Exchange into</u> <ul style="list-style-type: none"> ➤ Metal tappet ➤ Viton diaphragms

Installation with high pressure

Installation with slightly high pressure:

- * Use a stronger spring.
The level indicator will then function perfectly

With stronger high pressure:

- * Always manage a pressure balance between silo and indicator interior.
You will reach pressure balance, if you:
 - + Install a steel tube,
 - + Attach the steel tube to the tapped holes PG 11,
 - + Install the conductions within the steel tube,
 - + Lock the rear cover of the level indicator FMN 113 hermetically.




Install a small filter at the end of the open tube, if you utilize the level indicator with granular goods. This protects from the material.

Installation with very coarse-grained and sharp edged filling material

Install a rejection device with

- Filling material with rough granulations,
- Filling material with sharp edges,
- Filling material with high density.

The diagram shows an example:

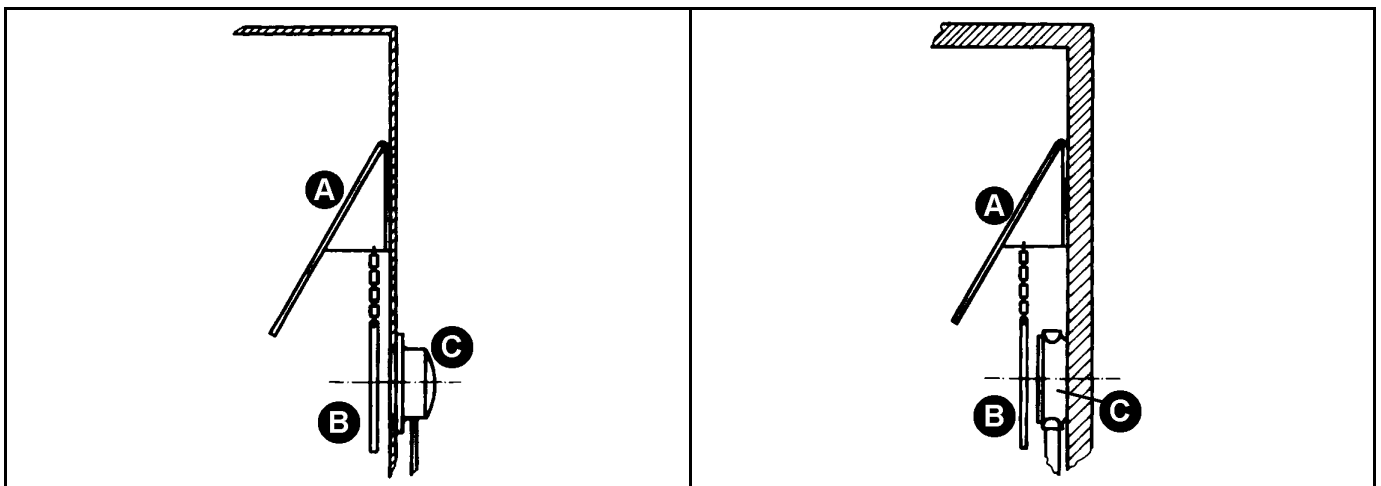

A = Rejection device

B = Curtain made of rubber
or plastic

C = level indicator


- The rejection device protects the level indicator and diaphragm from damages caused by falling filling material
- The curtain protects the diaphragm against high abrasion, because it lies over the diaphragm, if the filling level increases.



The indicator may not lie in the flow of the filling material, otherwise the indicator and diaphragm will be damaged rapidly.

Adjustment

The level indicators are adjustable for optimal sensitivity when delivered.

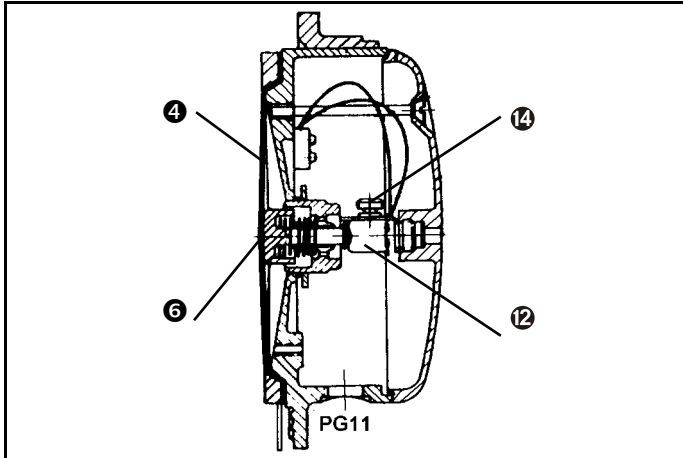

You must readjust your level indicator according to the different installation positions:

- * Detach knurled nut ⑭.
- * Turn micro switch ⑫ and
- * Press tappet ⑥,
Until the micro switch ⑫ produces an audible "click" (**working point**) when pressing slightly on the diaphragm ④.

The optimal operating point also depends on the filling material. During the micro-adjustment, pay attention:


The micro switch ⑫ must switch back into its resting position, if the filling material decreases.

- * Now tighten knurled nut ⑭.

Exchange the reset spring

The standard reset spring force is 20p.

The two reset springs provided in addition have a resetting force of 60p and 250p.

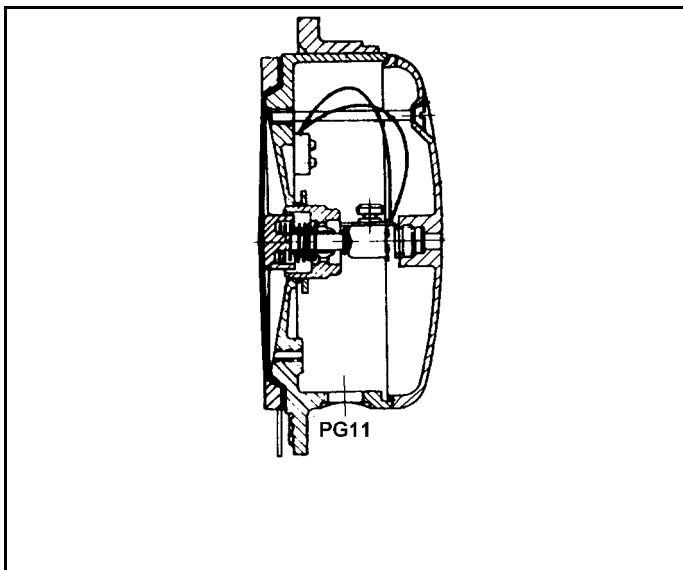

You should install a stronger reset spring for:


- "Empty indicators" in the lower part of larger silos,
- Level indicators in silos with filling materials of higher density (sand, gravel etc.).
- * Remove locking ring ①,
- * Completely unscrew adjustable lining ③, reset spring ⑦ and tappet ⑥ komplett heraus-schrauben.
- * Now remove tappet ⑥ from adjustable lining ③.
(The reset spring is now removable)

- * Reassemble in the reverse order.

During reassembly, pay attention to:

- The adjustable lining ③ should fit almost flush with the metal wall behind the diaphragm ④, if you reinstall ③, ⑦, ⑥ again.
- * Adjust the level indicator afterwards.

Circuit diagram

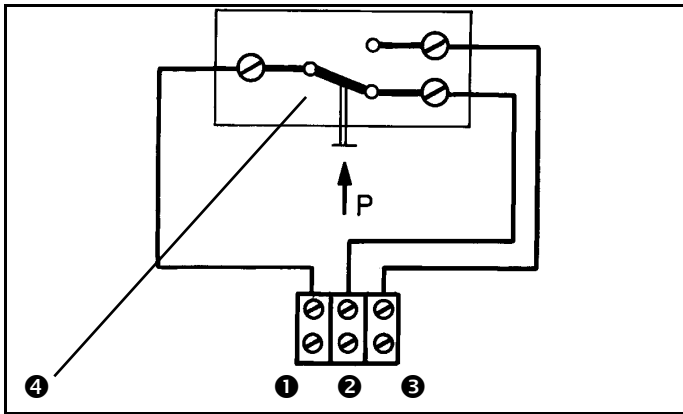


- ❶ = Input lead
- ❷ = Normally closed contact
(e.g. empty alarm)
- ❸ = Normally opened contact
(e.g. full alarm)
- ❹ = Micro switch

The single-pole two-way contact of the micro switch is loadable up to max. 15 A with an operating voltage of 250V alternating current.

You can use level indicators:

- to generate optical and acoustic signals, if a certain level is reached
- to control switches (automatic on/off-switching of transportation equipment).
- to automatically refill a silo after an empty alarm.
- to automatically stop the filling after a full alarm

Maintenance

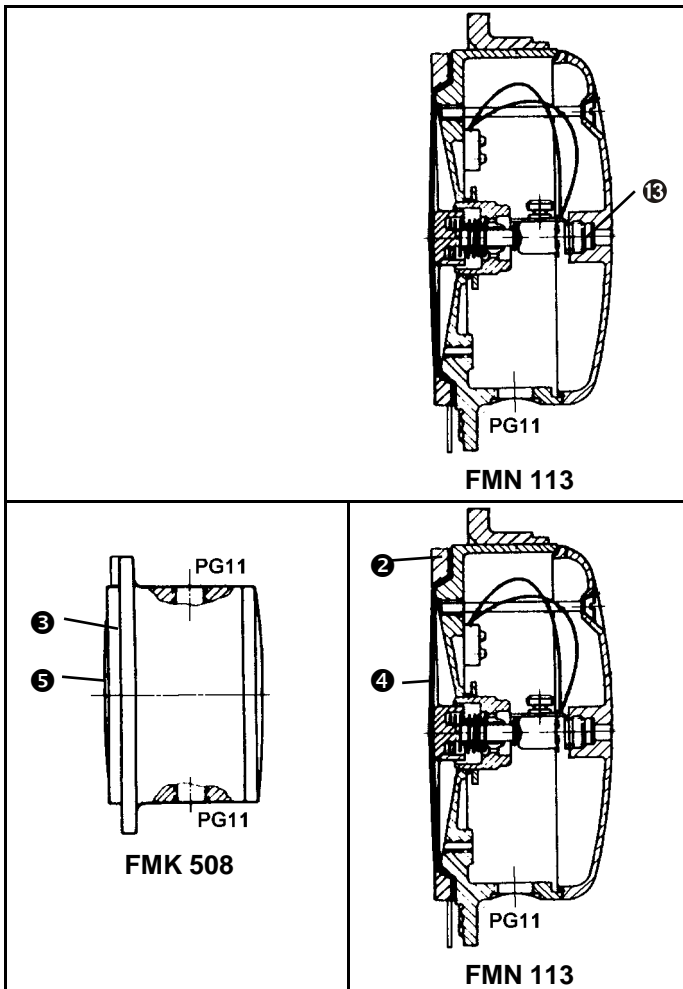

Dust deposits

Can make the balancing filter ❸ of level indicator FMN 113 ineffective after a long operation time:

- * Clean the dust collectors regularly (if necessary replace them).

Sharp edged filling material

Can cause abrasion of the diaphragm

- * Regularly check the diaphragms (if necessary replace them).

Exchanging diaphragms:

- * Detach and remove the screws of the diaphragm guard ring ❷ (❸)
- * Exchange diaphragm ❹ (❺) auswechseln.
- **The plane surface of the diaphragm must be outside**
- * Plug the screws into the holes of the new diaphragm and the guard ring and tighten adequately.
- **The bolt circle on the flat diaphragm is deliberately a little larger than the guard ring.**

Thus the initial tension of the diaphragm isn't too high.

- * Readjust the level indicator afterwards.

SPARE PART LIST

January 13, 2024

FMK 508	
13-772	Level indicator FMK 508 Pb
13-780	Level indicator FMK 508 Vt
13-839	Housing cover FMK
13-821	Diaphragm guard ring (Plastic)
15-934	Tapped / Ram
15-918	Adjustable lining
13-798	Diaphragm MF 08 Pb
13-805	Diaphragm MF 08 Vt
15-835	Micro switch
13-813	Gasket
53-364	Gasket cover 508
15-885	Pressure spring 20p
15-893	Pressure spring 60p
15-900	Pressure spring 250p

FMN 113	
13-772	Level indicator FMK 113 Pb
13-780	Level indicator FMK 113 Vt
13-904	Housing cover FMN
13-897	Diaphragm guard ring (Plastic)
14-005	Diaphragm guard ring (Stainless steel)
15-934	Tapped / Ram
15-918	Adjustable lining
13-863	Diaphragm MF 13 Pb
13-871	Diaphragm MF 13 Vt
15-835	Micro switch
13-889	Gasket
53-348	Gasket cover 113
15-885	Pressure spring 20p
15-893	Pressure spring 60p
15-900	Pressure spring 250p

Spare parts from the FMK and FMN series
are compatible with former manufacturers..

TECHNISCHES BÜRO GRIEB

Germany

EMIL NIETHAMMER GMBH

Germany

Please refer to the spare parts list for the part number
or send questions to info@zimsotec.de.

ZIMSOTEC

Sebastian Zimmermann
Am Buchenrain 13
74343 Sachsenheim | Germany

Phone: +49 7046 / 3080504
Web: www.zimsotec.de
Mail: info@zimsotec.de